


EM=236

LCMS Scan ESI+

Ret. Time: 4.44


<<<< POSITIVE SPECTRA >>>>

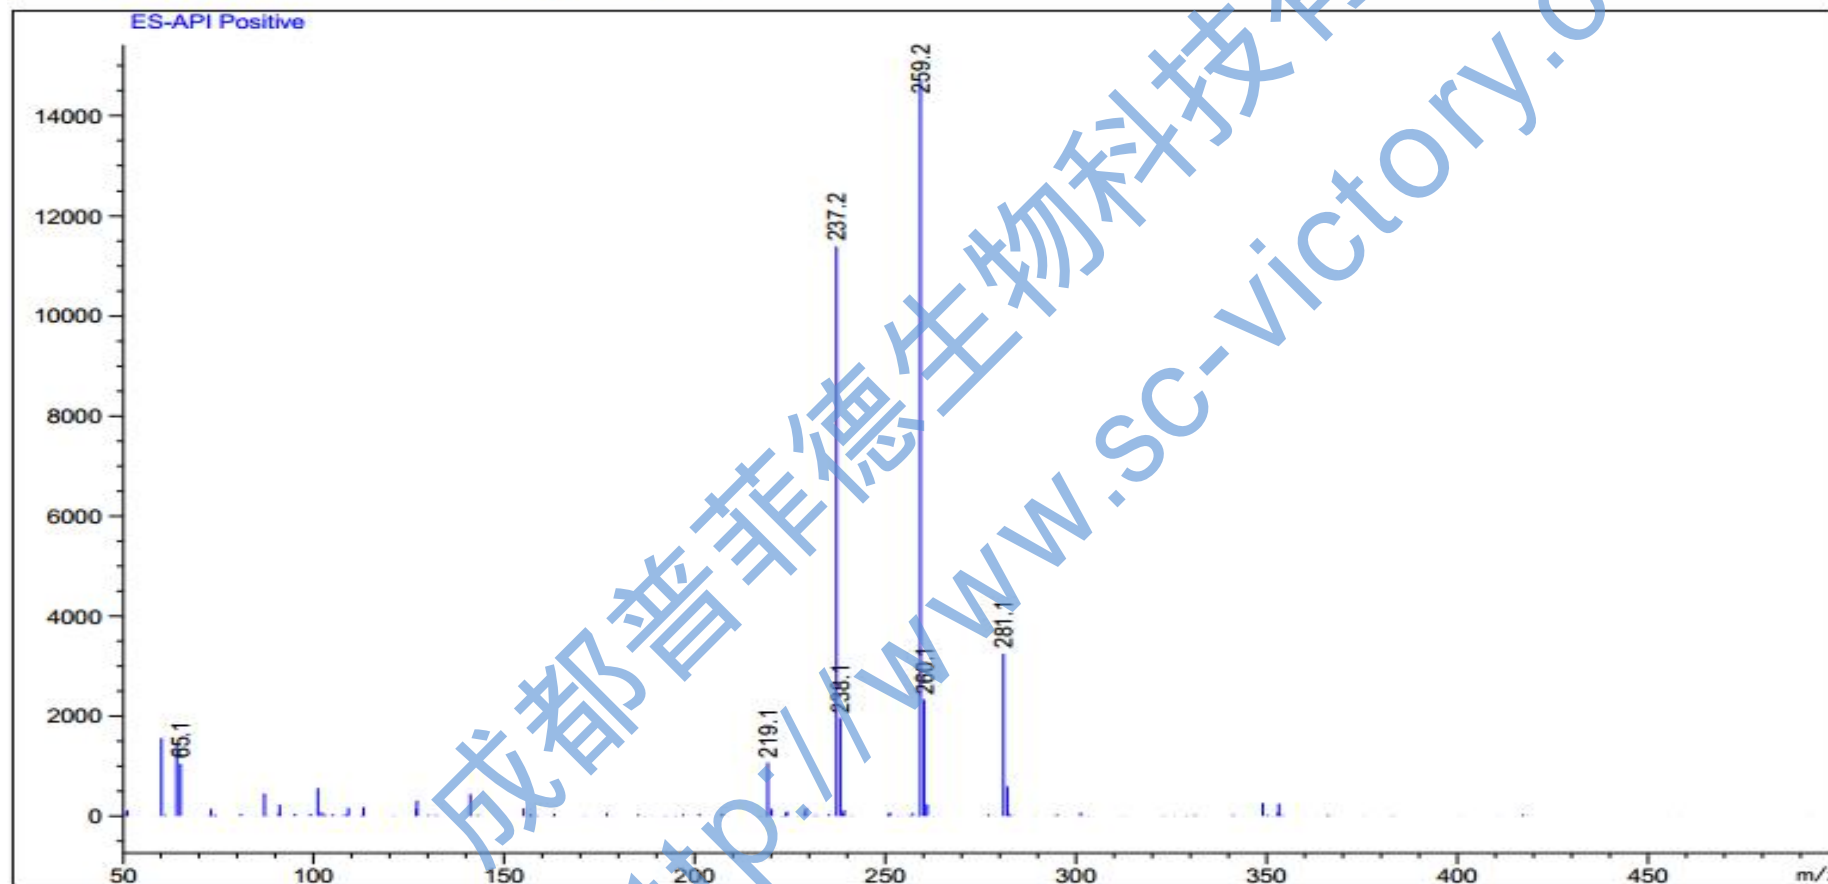

EM=236

LCMS Scan ESI-

Ret. Time: 4.44

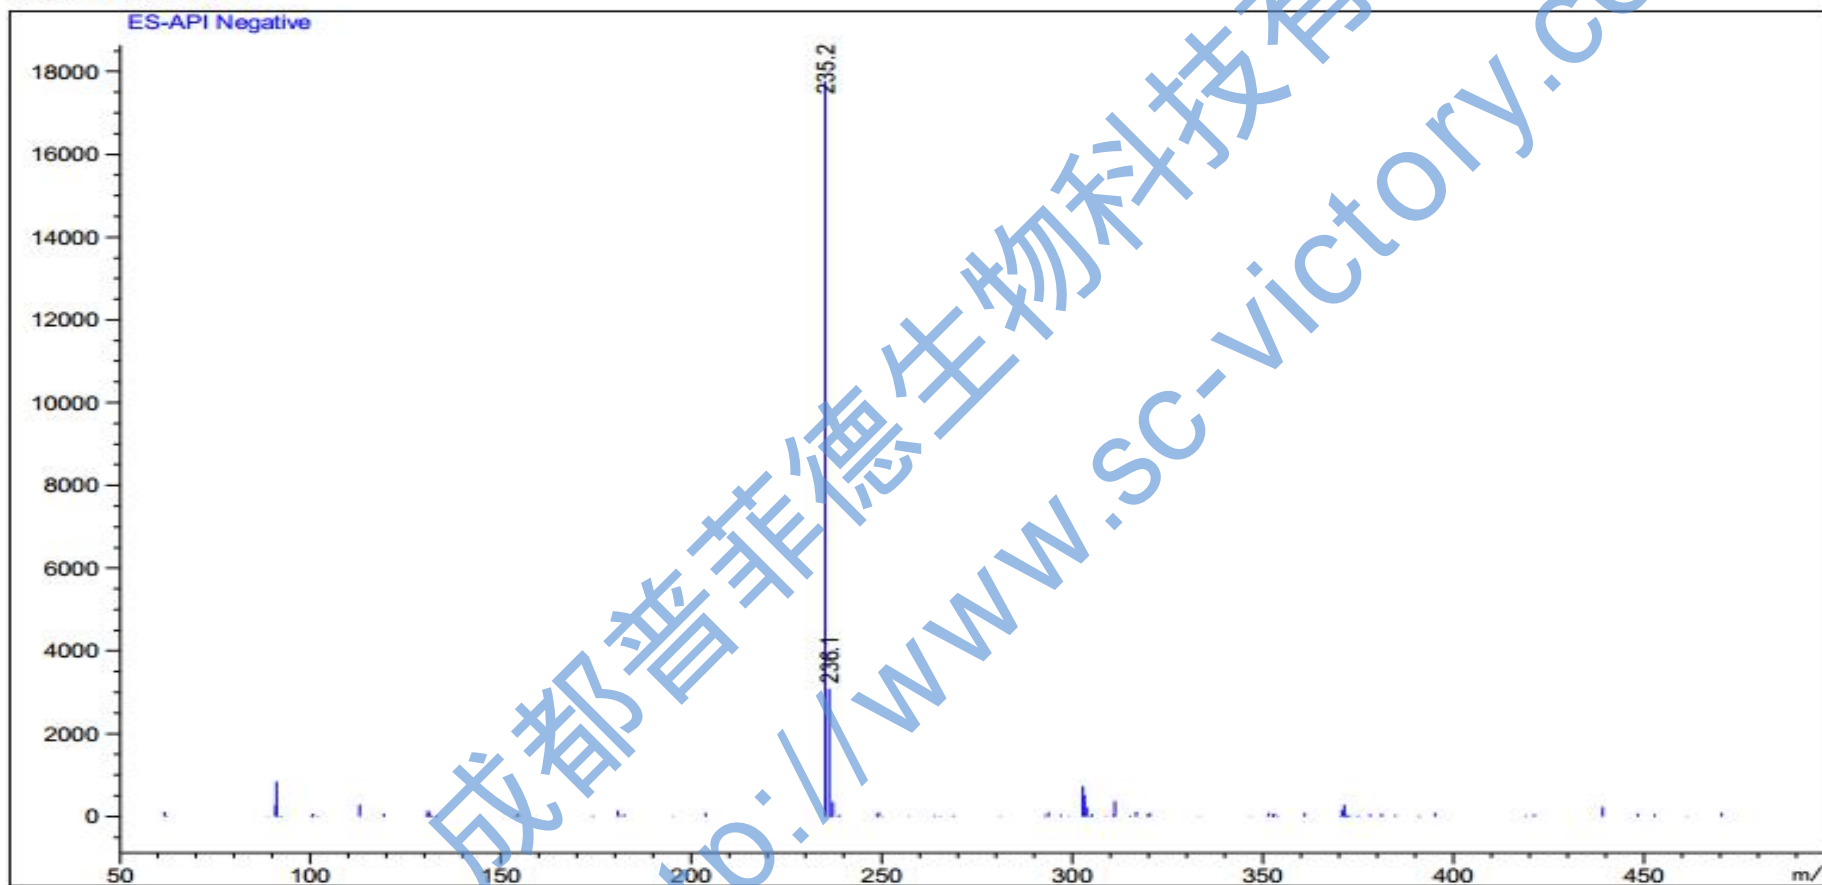

成都普菲德生物科技有限公司
<http://www.sc-victory.com>