


EM=288

LCMS Scan ESI+

Ret. Time: 3.11

<<<< POSITIVE SPECTRA >>>>

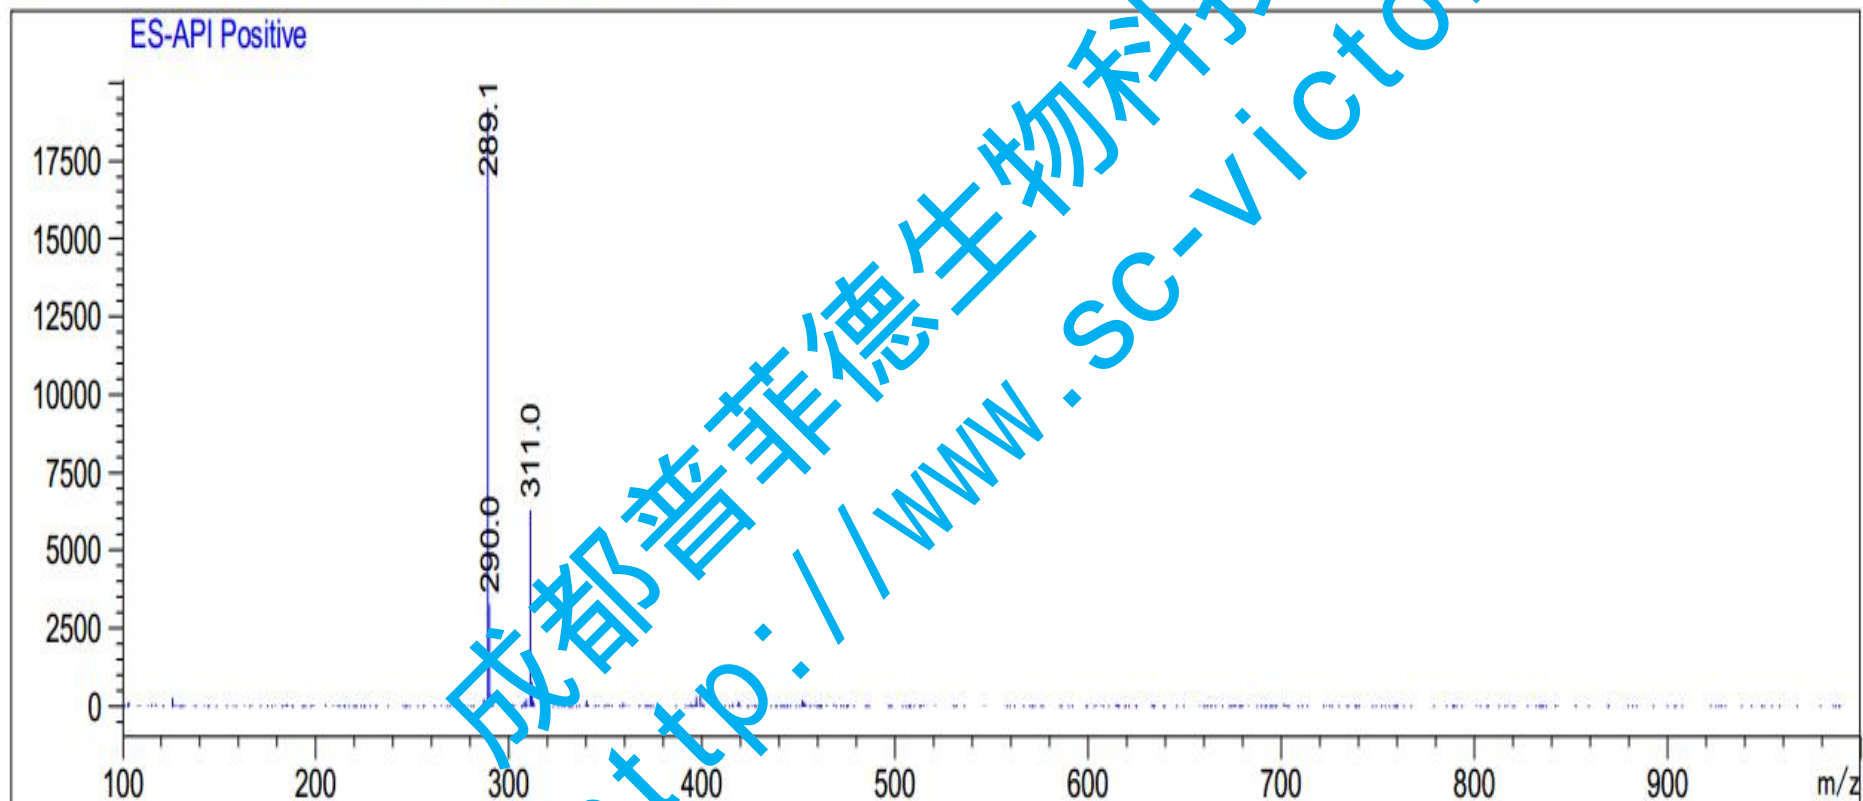


成都普菲德生物科技有限公司
<http://www.sc-victory.com>

EM=288

LCMS Scan ESI-

Ret. Time: 3.10

<<<< NEGATIVE SPECTRA >>>>

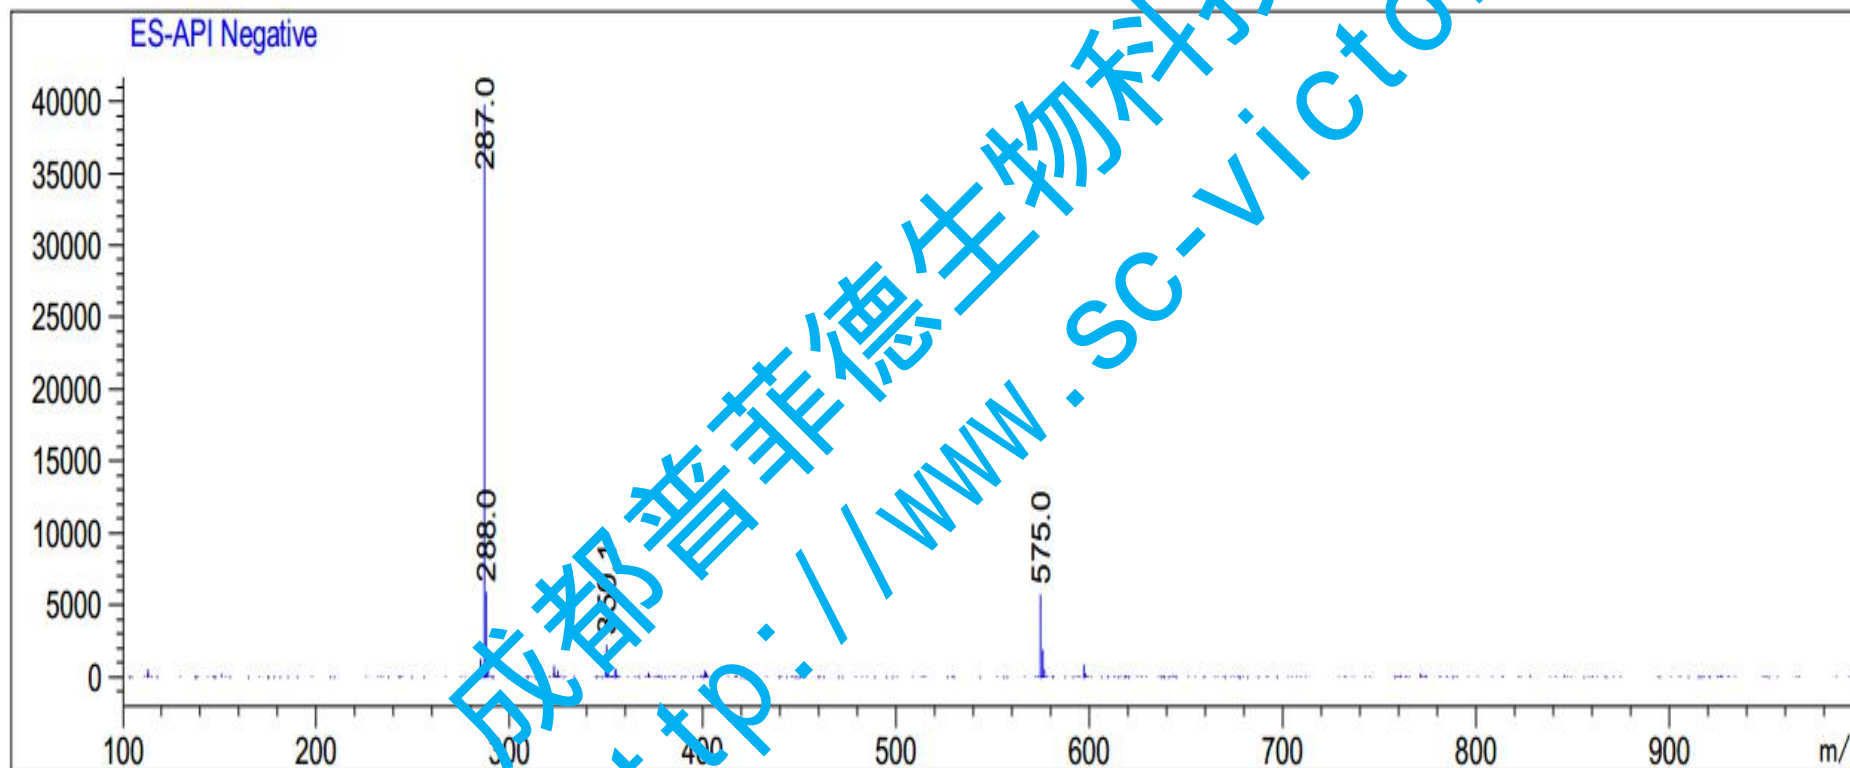

成都普菲德生物科技有限公司
<http://www.sc-victory.com>